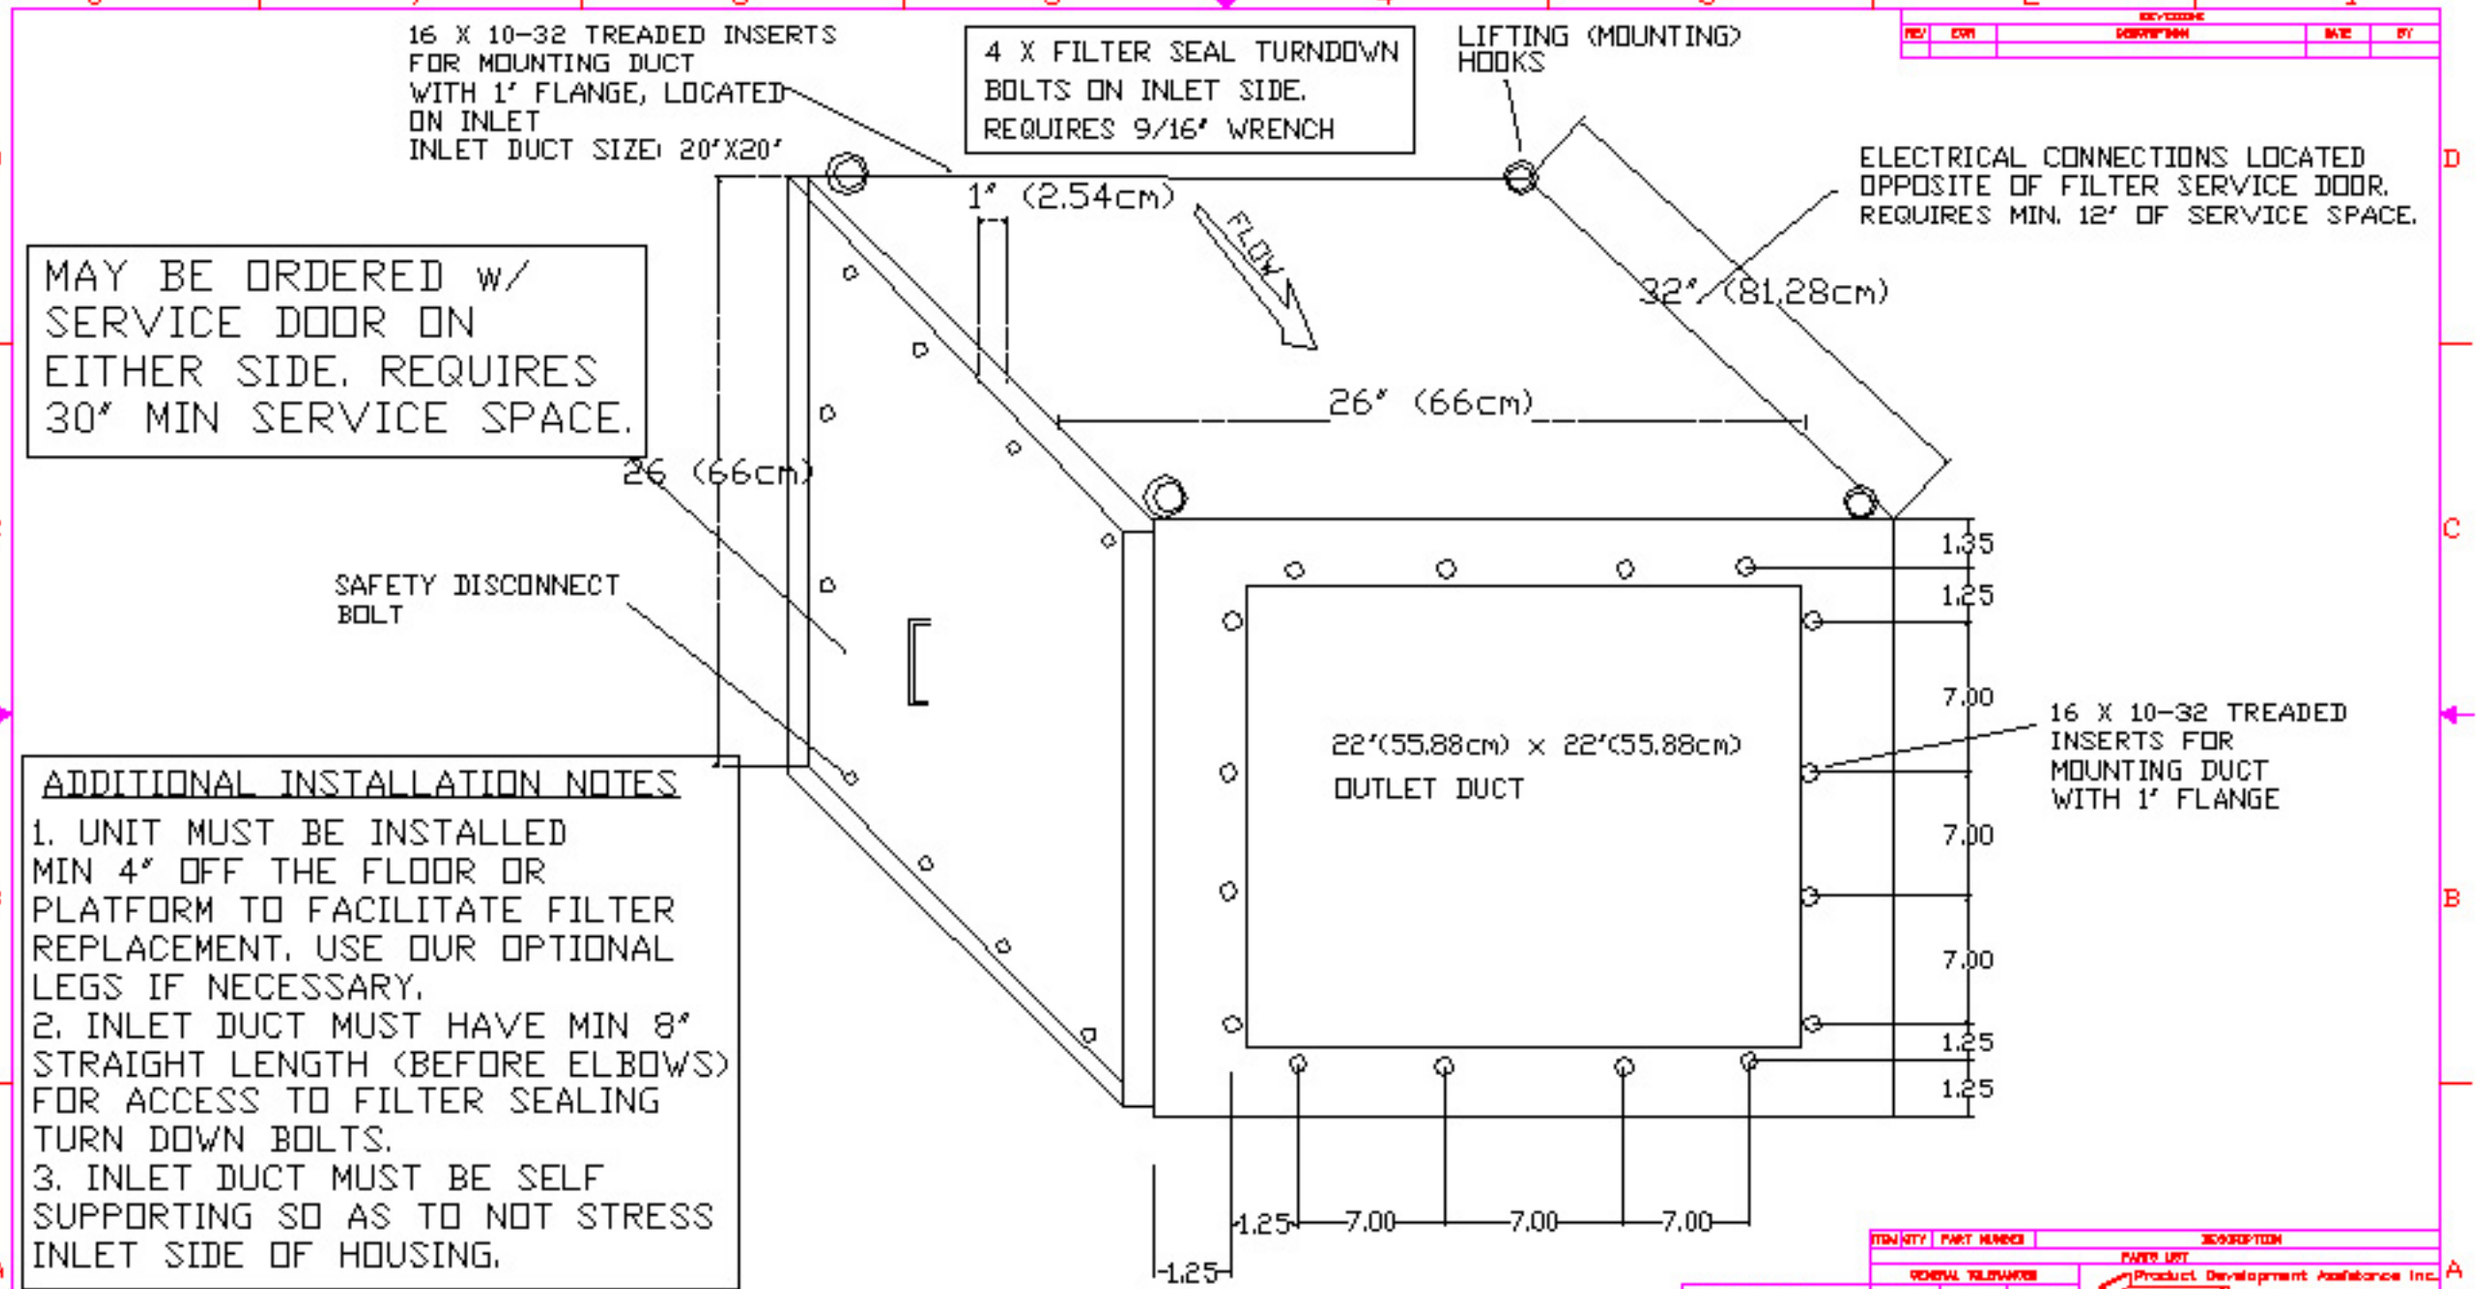

ADDITIONAL INSTALLATION NOTES

1. UNIT MUST BE INSTALLED MIN 4" OFF THE FLOOR OR PLATFORM TO FACILITATE FILTER REPLACEMENT. USE OUR OPTIONAL LEGS IF NECESSARY.
2. INLET DUCT MUST HAVE MIN 8" STRAIGHT LENGTH (BEFORE ELBOWS) FOR ACCESS TO FILTER SEALING TURN DOWN BOLTS.
3. INLET DUCT MUST BE SELF SUPPORTING SO AS TO NOT STRESS INLET SIDE OF HOUSING.

MODEL 1001 SUBMITTAL

Product Development Assistance Inc.
dba TECHNOVATION
Tel 804-744-0404 Fax: 804-744-0477

MODEL 1001
SIZE D
NUMBER 1001 ISO